

SF-1211  
02/2013

FOOTBALL FIELD  
95DR / 8005 (8)

117 x 75 m (73)  
[ 105 + (2 x 7.5) ] x [ 68 + (2 x 6 m)]

91DHL sprinkler replaced by 8005 (8)  
Water supply : 19 m<sup>3</sup>/h @ 7.5 bar

**LIST OF MATERIAL**

	<u>Description</u>	<u>Quantity *</u>
8005-SS	Sprinkler 8005-SS stainless steel riser sleeve	8 u
Falcon PC-SS	-	u
Falcon FC-SS	-	u
950E	-	u
B99500	-	u
B81600-22	8005 nozzle #22, yellow	8 u
212215-30	-	u
SJ-12-100-22	1" (26x34) Swing joint - length : 30 cm BSP/BSP	8 u
SJ-12-150-23	-	u
150-PGA	-	u
200-PGA	-	u
300-BPE	-	u
VB-JMB-H	-	u
VB-JMB-6EXT	-	u
DBRY	-	u
IESP4MEEU	-	u
ESP-SM3	-	u
ESP-LXMe	-	u
ESP-LX-M-SM8	-	u
RSD-BEx	-	u
Ø40	-	m
Ø50	Ø50 HDPE pipes (10 bar) including fittings	70 m
Ø63	Ø63 HDPE pipes (10 bar) including fittings	80 m
Ø75	Ø75 HDPE pipes (10 bar) including fittings	60 m
Ø90	-	m
Ø110	-	m
DI 115	-	m
	-	u

Valve number:	8005-SS A3, 5, 8
Precipitation rate in mm/h	11,5
Irrigation run time per valve for an amount of 5 mm	26


\* ---- For a water supply and a controller located at 50 m from the field ----

**SF-1211**

**FOOTBALL FIELD**  
**95DR / 8005 (8)**

**117 x 75 m (73)**

$[ 105 + (2 \times 7.5) ] \times [ 68 + (2 \times 6 \text{ m}) ]$

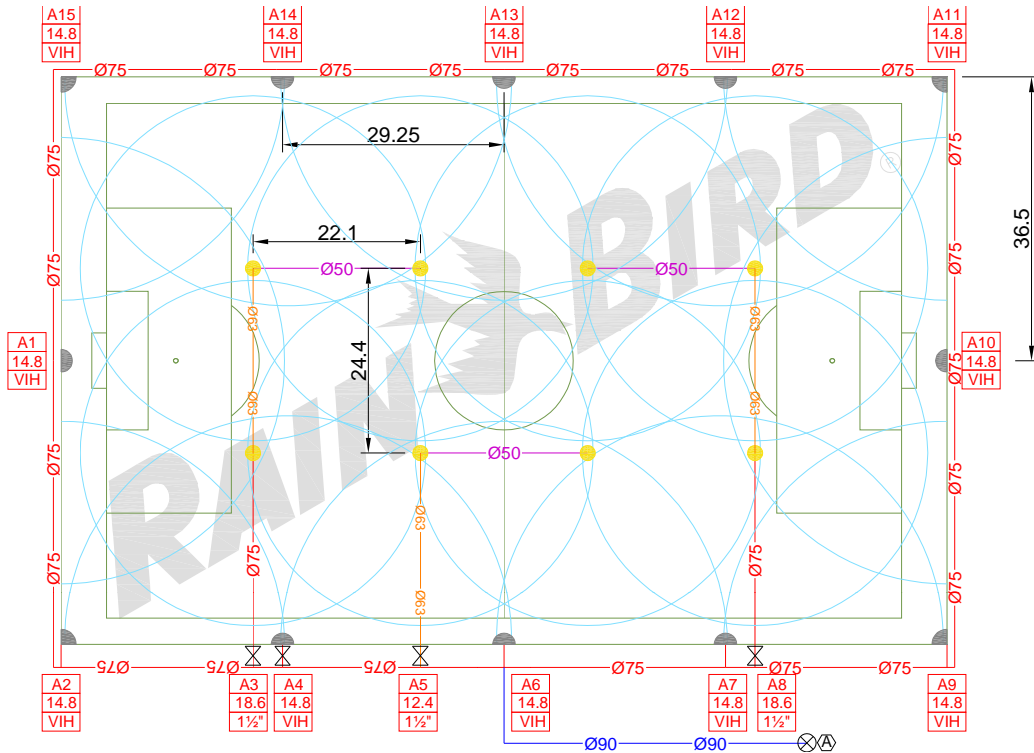

### Legend and technical data

- Controller and point of connexion with isolation valve
- Electricvalve

Sprinkler: 8005-SS  
 Nozzle: #22 ●  
 Pressure in bar: 5,5  
 Radius in m: 22,8  
 Flow in m<sup>3</sup>/h: 6,19

Controller/Station/Flow/Size of the valve

A3
20.5
2"

### Note :

HIGH DENSITY POLYETHYLENE PIPES: PE63 PN10 - ADDITIONAL LATERALS OUTSIDE PLAY FIELD AREA MAY BE INSTALLED PROVIDED HYDRAULIC CAPABILITY OF SUPPLY IS NOT EXCEEDED - SPRINKLER LOCATIONS ARE TO SCALE. PIPE LOCATIONS ARE DIAGRAMMATIC.

Rain Bird presents this plan as a typical sports field layout. Rain Bird offers no indemnity, expressed or implied, for projects installed from this plan. Since each site and system contains many variables, Rain Bird expressly recommends the use of a qualified irrigation designer.